




Safety and Quality

FireNet Gateway 3.0

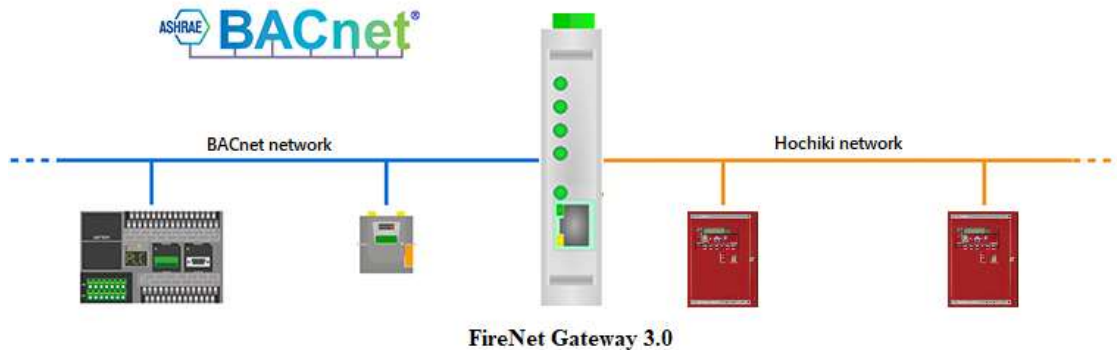

Systems

| | |
|-------|----------------|
| CPU | 32 bit 533MHz. |
| SDRAM | 128MB. |
| FLASH | 128MB. |

Communication ports

| | |
|----------|--------------------------|
| COM port | 02xRS232, 115200bps. |
| Ethernet | 01xEthernet 10/100 Mbps. |

Protocol

| | |
|----------------|---------------------------------------|
| BACnet | BACnet/IP server. |
| BACnet Objects | AI, AO, AV, BI, BO, BV (500 maximum). |
| HVAC interface | Hochiki FireNet. |

HUNG HIEU COMPANY LIMITED

Address: No. 162A Hoa Bang St., Yen Hoa Ward, Cau Giay Dist., Ha Noi City, Viet Nam.

Telephone: +84 243 782 1467

Hotline: +84 098 922 3439

Fax: +84 243 782 1465.

E-mail 1: hunghieucom@vnn.vn

E-mail 2: dungntien@hunghieu.com.vn

E-mail 3: dungntien@gmail.com

Website: www.hunghieu.com.vn.